

aurecon

*Bringing ideas
to life*

Magnetic Field Assessment

Beaconsfield to Kingsford 132kV
Underground feeder 264 Replacement
(A2K)

Ausgrid

Reference: 522165

Revision: 1

2022-08-18



Document control record

Document prepared by:

Aurecon Australasia Pty Ltd

ABN 54 005 139 873

Level 5, 116 Military Road

Neutral Bay NSW 2089

PO Box 538

Neutral Bay NSW 2089

Australia

T +61 2 9465 5599

F +61 2 9465 5598



E sydney@aurecongroup.com

W aurecongroup.com

A person using Aurecon documents or data accepts the risk of:

- a) Using the documents or data in electronic form without requesting and checking them for accuracy against the original hard copy version.
- b) Using the documents or data for any purpose not agreed to in writing by Aurecon.

Document control						aurecon	
Report title		Beaconsfield to Kingsford 132kV Underground feeder 264 Replacement (A2K)					
Document code		522165-W000001-REP-PD-A2K	Project number		522165		
File path		https://aurecongroup-my.sharepoint.com/personal/anuska_gautam_aurecongroup_com/Documents/Desktop/522165-W000001-REP-PD-A2K.docx					
Client		Ausgrid					
Client contact				Client reference			
Rev	Date	Revision details/status	Author	Reviewer	Verifier (if required)	Approver	
0	2022-07-27	Circulation draft	P Flanagan	A Gautam		C Boyle	
1	2022-08-18	Initial Issue	P Flanagan	A Gautam		C Boyle	
Current revision		1					

Approval			
Author signature		Approver signature	
			
Name	Paul Flanagan	Name	Chris Boyle
Title	Principal Engineer	Title	Technical Director



Contents

1	Background and Scope.....	5
1.1	Background	5
1.2	Scope.....	5
1.3	Structure of Report	6
2	Overview of Electric and Magnetic Fields.....	7
2.1	General Description.....	7
2.2	Electric and Magnetic Field/Health Issue	7
2.3	Health Guidelines	7
2.4	Prudent Avoidance	7
3	Input Information and Aspects of Field Predictions	8
3.1	Information Provided by Ausgrid	8
3.2	Assumptions and Exclusions for Modelling.....	9
3.3	Magnetic Field Dependence on Load.....	9
4	Characterisation of the Magnetic Field Contribution of the Proposed Works	10
4.1	Typical trefoil cable arrangement	10
4.2	Typical flat trench configuration.....	11
4.3	Flat Joint Bay Configuration	11
4.4	Summary of Magnetic Field Results.....	12
4.5	Magnetic Fields Experienced Intermittently.....	12
4.6	Magnetic Fields Experienced in Everyday Life	12
5	Compliance with EMF Standards and Prudent Avoidance / Precautionary Principles	13
5.1	Compliance with Health Standards	13
5.2	Assessment against Prudent Avoidance Principles	13
6	Conclusions	14

Appendices

Appendix A

General Description of Electric and Magnetic Fields

Appendix B

Overview of EMF Health Issue

Appendix C

Health Guidelines

Appendix D

Prudent Avoidance

Figures

Figure 1-1: Proposed underground cable route Beaconsfield - Kingsford

Figure 3-1: Trefoil Arrangement

Figure 3-2: Flat Arrangement

Figure 3-3: Joint Bay Arrangement

Figure 4-1: Predicted magnetic field contribution: Typical trefoil trench configuration

Figure 4-2: Predicted magnetic field contribution: Typical flat trench configuration

Figure 4-3: Predicted Magnetic Field Contribution: Typical flat Joint Bay

Tables

Table 2-1: ICNIRP Guideline Reference Levels (General Public)

Table 4-1: Predicted Highest TWA Magnetic Field Contribution (mG)

Table 4-2: Magnetic Field Levels Associated with Appliances and Utility Infrastructure

Table 6-1: Predicted Highest TWA Magnetic Field Contribution (mG)

Table C-2: Health Guideline Reference Levels

1 Background and Scope

1.1 Background

It is understood that, in order to increase supply reliability, Ausgrid is proposing to replace an aging fluid-filled sub-transmission feeder (264) between Transgrid's Beaconsfield Substation and Ausgrid's Kingsford Substation with new XLPE cables and is currently preparing an Environmental Assessment report. In connection with that report, Ausgrid has engaged Aurecon to undertake an assessment of the power frequency magnetic fields likely to be associated with the proposed feeder.

The proposed cable route is shown in Figure 1-1.

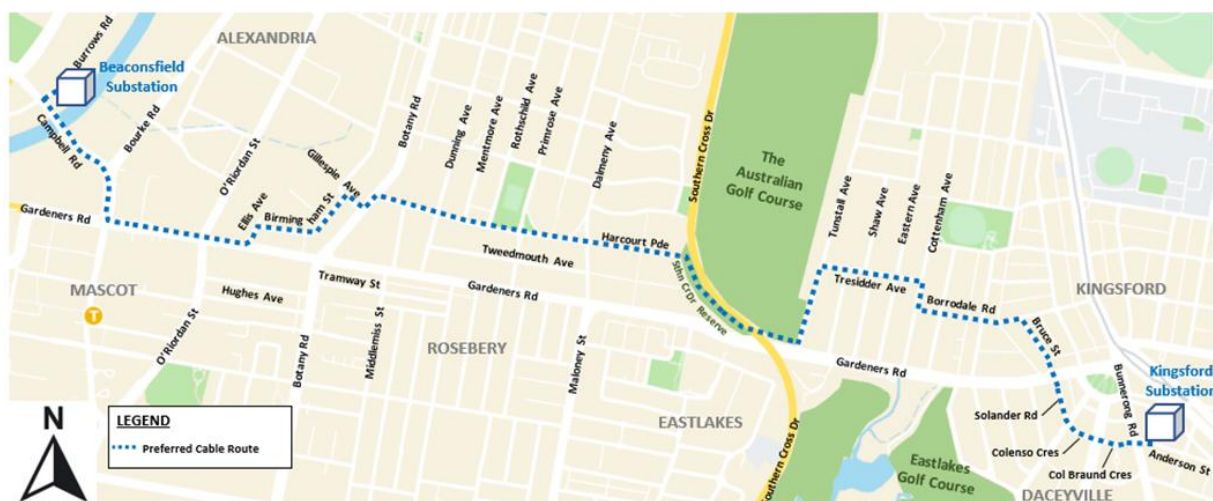


Figure 1-1: Proposed underground cable route Beaconsfield - Kingsford

The project will involve the installation of one, three-phase underground cable circuit, mainly in the carriageway of roads.

1.2 Scope

The scope of Aurecon's assignment covers the following:

- Provide a brief description of the EMF health issue.
- Calculate the time weighted average (TWA)¹ magnetic fields likely to be associated with the proposed feeder shortly after commissioning (scheduled for 2024), after network changes proposed for 2034, and in the ultimate case. The calculations are to be undertaken at 1m above ground level and extending up to 25m on each side of the trench centreline for the following configurations:
 - single circuit trefoil, (representing the bulk of the route)
 - flat configuration, which may be required to avoid other services, and
 - single joint bay.
- Assess the compliance of the anticipated field levels with the relevant national and international EMF guidelines.
- Assess the compliance of the proposed feeder with precautionary and prudent avoidance principles as defined in the relevant guidelines.
- Prepare an EMF assessment report to inform the overall environmental assessment.

¹ The time weighted average magnetic field is the average of a number of measurements taken at regular intervals over a specified time e.g 24 hours, a week or a year. It is commonly used as a dose-metric for environmental agents.

1.3 Structure of Report

Section 2 provides background information on the EMF and human health issue and Section 3 documents the relevant information supplied by Ausgrid.

Section 4 contains predictions of the EMF levels associated with the proposed works.

Section 5 addresses the proposed design in the context of compliance with EMF guidelines and precautionary/prudent avoidance principles.

Conclusions are presented in Section 6.

Further information regarding electric and magnetic fields and human health is contained in Appendices A to D.

2 Overview of Electric and Magnetic Fields

2.1 General Description

Whenever electrical equipment is in service, it produces an electric field and a magnetic field. Accordingly, electric and magnetic fields are common throughout the modern everyday environment². The electric field³ is associated with the voltage of the equipment and the magnetic field is associated with the current (amperage). In combination, these fields cause energy to be transferred along electric wires.

The electric and magnetic fields associated with electrical equipment, whilst interrelated, are not dependent on each other and can exist independently.

Further detail on electric and magnetic fields can be found in Appendix A.

2.2 Electric and Magnetic Field/Health Issue

The possibility of adverse health effects due to the EMFs associated with electrical equipment has been the subject of extensive research throughout the world for more than 40 years. To date, while adverse health effects have not been established, the possibility that they may exist cannot be ruled out. Further discussion of the EMF/health issue can be found in Appendix B.

2.3 Health Guidelines

Since late 2015, the relevant Australian regulator, the Australian Radiation Protection and Nuclear Safety Agency (ARPANSA), has adopted the international guideline published by the International Commission on Non-Ionising Radiation Protection (ICNIRP) in 2010. Details of the current guideline “Reference Levels” for electric and magnetic field exposure can be found in Appendix C. These “Reference Levels” have been used as the principal assessment criteria for this assignment and are reproduced in Table 2-1 below. The criteria are independent of duration of exposure.

Table 2-1: ICNIRP Guideline Reference Levels (General Public)

Parameter	Reference Level
Electric Field	5,000 Volts per metre (V/m)
Magnetic Field	2,000 milliGauss (mG)

2.4 Prudent Avoidance

Given the inconclusive nature of the science regarding EMF and human health, it is widely considered that a prudent approach is the most appropriate response under the circumstances. Under this approach, subject to modest cost and reasonable practicality, the owners of electric power infrastructure should design their facilities to reduce the intensity of the fields they generate in frequented areas.

In the Australian context, the Energy Networks Association, of which Ausgrid is a member, has produced an EMF Management Handbook (Ref D-5), which addresses Prudent Avoidance in the following terms:

“Prudent avoidance does not mean there is an established risk that needs to be avoided. It means that if there is uncertainty, then there are certain types of avoidance (no cost / very low-cost measures) that could be prudent.”

² More information on everyday magnetic fields is contained in Section 4.6.

³ The electric field associated with underground cables is contained within the cable and, hence, there is no external electric field.

It also states:

“Both prudent avoidance and the precautionary approach involve implementing no cost and very low-cost measures that reduce exposure while not unduly compromising other issues.”

Further discussion on this subject can be found in Appendix D.

3 Input Information and Aspects of Field Predictions

3.1 Information Provided by Ausgrid

The input data required for the calculations on which this assessment is based has been supplied by Ausgrid and is summarised below.

- Details of the proposed route.
- Drawings showing the relative locations and electrical phasing of the individual cables comprising the proposed feeders. (Refer to Figure 3-1 and Figure 3-2)
- Drawings showing the proposed cable arrangements for the joint bays along the route (Figure 3-3).
- Forecast time weighted average loading information for the proposed feeder, together with an instruction to model separately the 2025 load, the 2034 load following proposed network reconfiguration, and the ultimate winter load scenarios. This resulted in load currents of 131, 145 and 348 Amps per phase respectively.
- Information regarding the maximum thermal ratings of the proposed cables, to enable consideration of the maximum current loading which could theoretically be carried, although such loading is unlikely to occur.



Spacing between phases: 184mm

Cover to top phase: 857 mm

Figure 3-1: Trefoil Arrangement



Spacing between phases: 230mm

Cover to cables: 847 mm

Figure 3-2: Flat Arrangement



Spacing between phases: 400 mm

Cover to cables: 1350 mm

Figure 3-3: Joint Bay Arrangement

3.2 Assumptions and Exclusions for Modelling

As instructed by Ausgrid, Aurecon has modelled the magnetic field levels associated with the proposed 132kV underground cable feeder. The characterisation of the field levels associated with other existing sources which may be found along the routes of the proposed new feeders is beyond the scope of this report.

3.3 Magnetic Field Dependence on Load

The magnetic fields from electrical equipment depend on the loadings at that particular time. Accordingly, in characterising the magnetic fields from an item of electricity infrastructure, it is necessary to make practical assumptions regarding the loadings on the equipment at these sites.

During a typical day, the amount of load current passing through a sub transmission network will vary substantially between a daily minimum, generally in the early hours of the morning and a daily maximum at times of peak demand. Loadings also vary seasonally during the year, generally reaching a peak in either summer or winter. Loads may also grow slowly over time, due to a wide variety of factors. It is these various actual loadings which are relevant in the health context, rather than the maximum capacity of an electrical asset, which may only be required for very short periods, under emergency conditions, a few times over its service life.

Given that the epidemiological associations which underpin community interest regarding magnetic fields tend to relate to elevated "time-weighted average" magnetic fields, it is logical to select the time weighted average loads for detailed modelling. The magnetic fields derived under these conditions are the most appropriate for consideration in the context of the magnetic field/health literature, rather than the maximum capacity of the feeder, which may only be required for very short periods, under emergency conditions, a few times over its service life.

It should be noted that, following completion of the proposal, the magnetic fields at any particular time would be dependent on the actual loadings rather than those used for calculation purposes.

4 Characterisation of the Magnetic Field Contribution of the Proposed Works

Based on the available design and loading information, provided by Ausgrid, the magnetic field contribution expected from the proposal has been modelled using established in-house software which has been extensively validated against other comparable software.

Since the same trench and joint bay configurations will be used throughout the route, Aurecon has modelled:

- A typical trefoil cable arrangement (expected to be used for the bulk of the route).
- A typical flat cable arrangement
- A typical flat joint bay configuration
- Calculated the magnetic field contribution associated with each of the above scenarios; and

The results of the modelling are documented in Sections 4.1, 4.2, and 4.3.

The calculated magnetic field contributions are presented as profiles extending 25m either side of the centreline of the cable trench and have been calculated at a height of 1 m above ground level in accordance with international practice. All calculations have been undertaken using the time-weighted average forecast loads provided by Ausgrid, as noted in Section 3.1.

As previously noted, following completion of the proposed works, the magnetic fields would be dependent on the actual loading rather than that used for calculation purposes.

4.1 Typical trefoil cable arrangement

The magnetic field contribution directly above a typical trefoil trench configuration is shown in Figure 4-1.

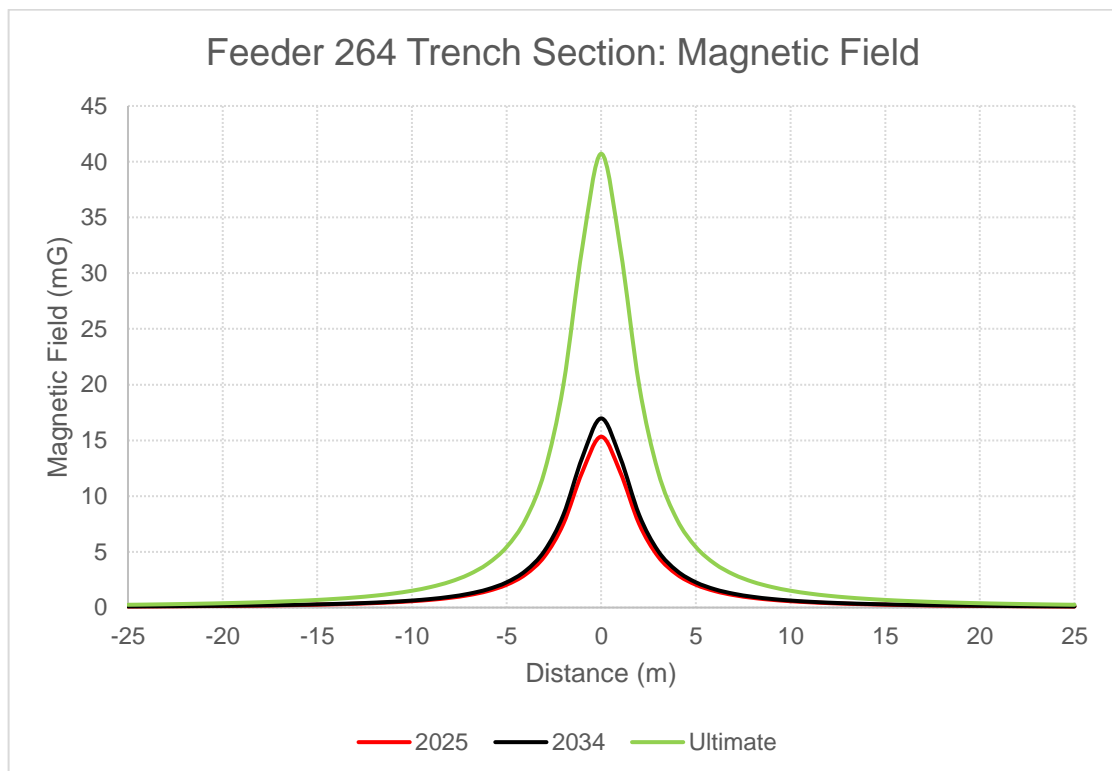


Figure 4-1: Predicted magnetic field contribution: Typical trefoil trench configuration

It can be seen that, shortly after commissioning, the predicted time-weighted-average magnetic field contribution directly above the cable trench is 15.3mG. This will increase progressively over time to an ultimate value of 40.7mG. At a distance of 10 metres from the trench centreline, the predicted field decreases to a less than 1mG initially and less than 2mG ultimately.

4.2 Typical flat trench configuration

The magnetic field contribution directly above a typical flat trench configuration is shown in Figure 4-2.

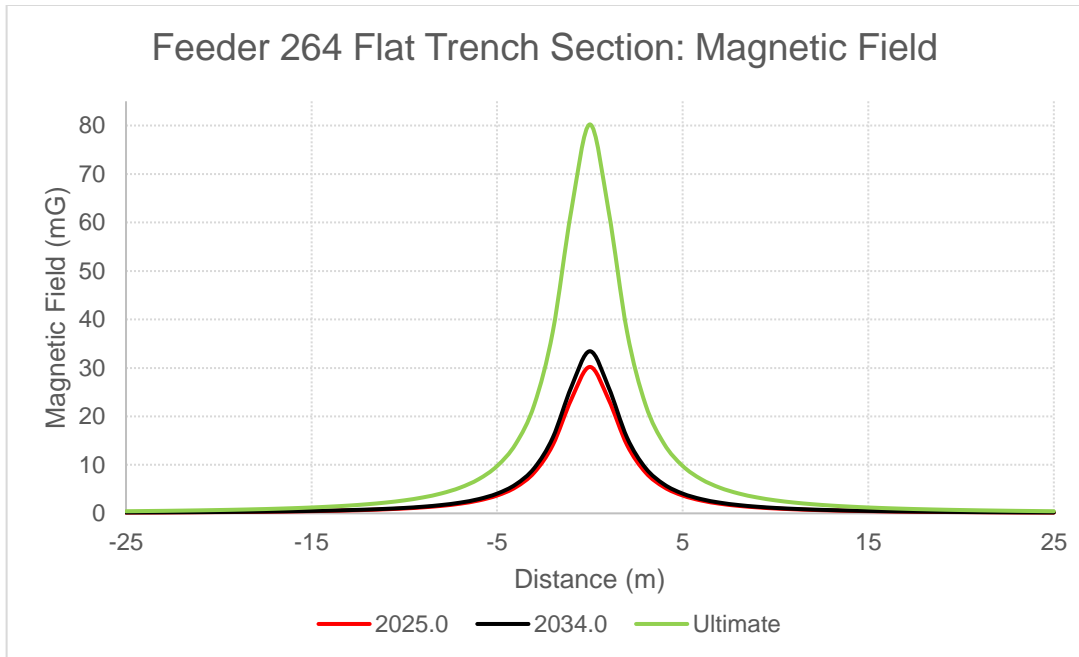


Figure 4-2: Predicted magnetic field contribution: Typical flat trench configuration

It can be seen that, shortly after commissioning, the predicted time-weighted-average magnetic field contribution directly above the cable trench is 30.2mG. This will increase progressively over time to an ultimate value of 80.2mG. At a distance of 10 metres from the trench centreline, the predicted field decreases to 1mG initially and 2.7mG ultimately.

4.3 Flat Joint Bay Configuration

The magnetic field contribution directly above a typical flat joint bay is shown in Figure 4-3.

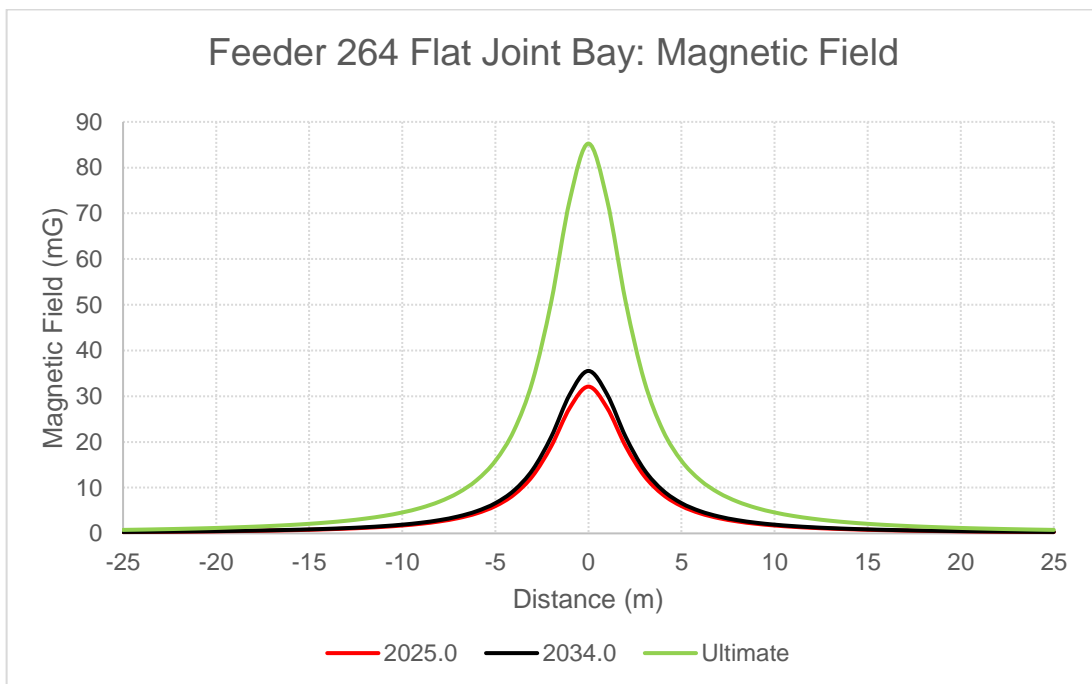


Figure 4-3: Predicted Magnetic Field Contribution: Typical flat Joint Bay

It can be seen that, shortly after commissioning, the predicted time-weighted-average magnetic field contribution directly above the joint bay is 32.1mG. This will increase progressively over time to an ultimate

value of 85.3mG. At a distance of 10 metres from the joint bay centreline, the predicted field decreases to 1.7mG initially and 4.6mG ultimately.

4.4 Summary of Magnetic Field Results

As outlined in Sections 4.1 to 4.3, the highest predicted magnetic field contribution of the proposed Beaconsfield to Kingsford feeder under time-weighted load conditions is shown in Table 4-1.

Table 4-1: Predicted Highest TWA Magnetic Field Contribution (mG)

Configuration	Cases			
	2025, above cables	2025, 10 metres from centre of trench	Ultimate Load, above trench	Ultimate load, 10m from centre of trench
Trefoil Configuration - Trench	15.3mG	<1mG	40.7mG	<2mG
Flat Configuration - Trench	30.2mG	1mG	80.2mG	2.7mG
Flat Joint Bay	32.1mG	1.7mG	85.3mG	4.6mG

4.5 Magnetic Fields Experienced Intermittently

While the field levels presented in Sections 4.1 to 4.3 are the most relevant in the health context, in the broader context of an environmental assessment⁴, it is also appropriate to recognise that, in the longer term, under emergency conditions, magnetic field contributions of up to 3 times those presented above could be experienced in some places for short periods over the life of the feeder. Such situations are only expected to arise rarely, if at all, and if so, would not be expected to be of prolonged duration.

4.6 Magnetic Fields Experienced in Everyday Life

In considering the fact that the predicted field levels associated with the proposed underground feeders are quite localised and will vary, depending on the actual loadings of the feeders, it is important to recognise that life in the modern world involves moving from one source of magnetic fields to another. To put the magnitude of the predicted magnetic fields into perspective, it is worth considering the range of typical magnetic field levels associated with common household appliances at normal user distances and utility infrastructure, shown in Table 4-2.

Table 4-2: Magnetic Field Levels Associated with Appliances and Utility Infrastructure

Appliances	Typical Measurement (mG)	Range of Measurements (mG)
Stove	6	2-30
TV	1	0.2-2
Electric Blanket	20	5-30
Hair Dryer	25	10-70
Refrigerator	2	2-5
Toaster	3	2-10
Kettle	3	2-10
Fan	1	0.2-2
Under Distribution Line	10	2-20
Under Transmission Line	20	10-200
Transmission Line – Edge of Easement	10	2-50

⁴ The ICNIRP Guideline Reference Levels are independent of duration and, accordingly, in assessing compliance with them, it is appropriate to consider the highest field which could theoretically occur.

From the above range of field levels, it can be seen that the magnetic field contribution of the proposed feeders typically falls within the range of those normally associated with power lines and some appliances. At a distance of 10m from both the trench and joint bay centrelines, the magnetic field contribution of these feeders is well within the range normally encountered in everyday life.

5 Compliance with EMF Standards and Prudent Avoidance / Precautionary Principles

5.1 Compliance with Health Standards

Magnetic Fields

The highest predicted time-weighted average magnetic field contribution directly above the normal cable trench is 40.7mG. This is 2% of the relevant ICNIRP general public exposure guideline level of 2000mG. At a distance of 10m from the centreline, the field contribution is predicted to reduce to a negligible level.

In highly localised areas above the joint bays, the highest predicted time-weighted average magnetic field contribution directly above a bay is 85mG. This is less than 5% of the relevant general public exposure guideline level. At a distance of 10m from the joint bays, the field contribution is predicted to reduce to 4.6mG or less, which is less than 0.3% of the relevant general public exposure guideline level.

Emergency Conditions

As noted in Section 4.5, it is also appropriate to recognise that higher magnetic field contributions could be experienced in some places for short periods under emergency conditions. Even under these conditions, the highest of these field contributions is still predicted to be generally less than 6% of the relevant ICNIRP general public exposure guideline level and less than 13% in the localised areas above the joint bays. Such situations are only expected to arise rarely, if at all, and if so, would not be expected to be of prolonged duration.

Electric Fields

Being of underground construction and contained within cables, the proposed feeders will not produce external electric fields.

5.2 Assessment against Prudent Avoidance Principles

As noted in Section 2.3, given the inconclusive nature of the science, it is considered that a prudent/precautionary approach continues to be the most appropriate response in the circumstances. Under this approach, power utilities should design their facilities to reduce the intensity of the fields they generate, and locate them to minimise the fields that people, especially children, encounter over prolonged periods, provided this can be readily achieved without undue inconvenience and at reasonable expense, and are consistent with good engineering and risk minimisation practice.

It is understood that, along with other members of ENA, Ausgrid has adopted the policy of prudent avoidance and there is clear evidence that it is applying it to this project. In this context, Ausgrid, over the course of the project, has or will:

- Openly share information regarding the EMF/health issue and the proposed underground cables
- Where practical, site the electrical infrastructure in road reserves, away from residential property boundaries, so that the magnetic field contribution at and beyond them will be lower
- Adopted an underground cable concept rather than less expensive overhead lines.

While it cannot be said with certainty that any of these measures are beneficial in terms of human health, they are consistent with the concept of prudent avoidance. Given the relatively low magnetic field levels

predicted in frequented areas, further field reduction measures are unlikely to be justified in the name of prudent avoidance.

6 Conclusions

The contribution of the proposed Beaconsfield to Kingsford underground feeder to the magnetic field environment along the proposed route has been modelled and assessed on the basis of the information currently available. The predicted field contributions have been assessed against the relevant health guidelines and the principles of prudent avoidance. In summary, our findings are as follows.

Magnetic Fields

The highest predicted magnetic field contributions of the proposed Beaconsfield to Kingsford feeder under time-weighted load conditions is shown in Table 6-1. The Table covers the initial (circa. 2025) and ultimate cases.

Table 6-1: Predicted Highest TWA Magnetic Field Contribution (mG)

Configuration	Cases			
	2025, above cables	2025, 10 metres from centre of trench	Ultimate Load, above trench	Ultimate load, 10m from centre of trench
Trefoil Configuration - Trench	15.3mG	<1mG	40.7mG	<2mG
Flat Configuration - Trench	30.2mG	1mG	80.2mG	2.7mG
Flat Joint Bay	32.1mG	1.7mG	85.3mG	4.6mG

The ultimate case is further summarised below:

The highest predicted time-weighted average magnetic field contribution directly above the normal cable trench is 40.7mG. This is 2% of the relevant ICNIRP general public exposure guideline level of 2000mG. At a distance of 10m from the centreline, the field contribution is predicted to reduce to a negligible level.

In highly localised areas above the joint bays, the highest predicted time-weighted average magnetic field contribution directly above a bay is 85mG. This is less than 5% of the relevant general public exposure guideline level. At a distance of 10m from the joint bays, the field contribution is predicted to reduce to 4.6mG or less, which is less than 0.3% of the relevant general public exposure guideline level.

Electric Fields

Being of underground cable construction, the proposed feeder will not produce external electric fields.

Prudent Avoidance Measures

Over the course of the project, consistent with the notion of prudent avoidance, Ausgrid has taken the following measures:

- Openly shared information regarding the EMF/health issue and the proposed underground cables;
- Where practical, sited the electrical infrastructure in road reserves, away from residential property boundaries, so that the magnetic field contribution at and beyond them will be lower;
- Adopted an underground cable concept rather than less expensive overhead lines.

While it cannot be said with certainty that any of these measures are beneficial in terms of human health, they are consistent with the concept of prudent avoidance. Given the relatively low magnetic field levels predicted in frequented areas, further field reduction measures are unlikely to be justified in the name of prudent avoidance.

Appendix A

General Description of Electric and Magnetic Fields

The electric and magnetic fields associated with electrical equipment, whilst interrelated, are not dependent on each other and can exist independently. The electric field is associated with the voltage of the equipment and the magnetic field is associated with the current (amperage). In combination, these fields cause energy to be transferred along electric wires.

An **electric field** is a region where electric charges experience an invisible force. The strength of this force is related to the voltage, or pressure, which forces electricity along wires. Electric fields are strongest closest to their source, and their strength diminishes rapidly with distance from the source, in much the same way as the warmth of a fire decreases with distance. Many common materials – such as brickwork or metal – block electric fields, so they are readily shielded and, for all practical purposes, do not penetrate buildings. They are also shielded by human skin, such that the electric field inside a human body will be at least 100,000 times less than the external field. (Ref A-1) Being related to voltage, the electric fields associated with HV aerial lines and electrical substations remain relatively constant over time, except where the operating voltage changes.

A **magnetic field** is a region where magnetic materials experience an invisible force produced by the flow of electricity (known as electric current and measured in Amperes). The strength of a magnetic field depends on the size of the current and decreases as distance from the source increases. The magnetic field strength resulting from an electrical installation varies continually with time and is affected by a number of factors including:

- The total electric load
- The size and nature of the equipment
- The design of the equipment
- The layout and electrical configuration of the equipment and its interaction with other equipment

While electric fields are blocked by common materials, this is not the case with magnetic fields. This is why locating equipment in enclosures or underground will eliminate any external electric field but not the magnetic field.

Alternating electric and magnetic fields are produced by any electric wiring or equipment carrying alternating current (AC). This current does not flow steadily in one direction but oscillates backwards and forwards at a frequency⁵ of 50Hz and hence the fields produced by AC systems oscillate at the same frequency. This frequency falls into a range referred to as **extremely low frequency (ELF)**, so the electric and magnetic fields are referred to as ELF fields.

Electromagnetic Radiation

It is not uncommon for the electric and magnetic fields (EMF) associated with electrical equipment to be confused with electromagnetic radiation (EMR). The fact that, in many jurisdictions, agencies which regulate the various forms of EMR are also involved in the setting of guidelines/standards for EMF tends to add to this confusion.

Electromagnetic radiation is a term we use to describe the movement of electromagnetic energy through the propagation of a wave. This wave, which moves at the speed of light in a vacuum, is composed of electric and magnetic waves which oscillate (vibrate) in phase with, and perpendicular to, each other. This is in contrast to EMF, where the electric and magnetic components are essentially independent of one another.

Electromagnetic radiation is classified into several types according to the frequency of its wave; these types include (in order of increasing frequency): radio waves, microwaves, terahertz radiation, infra-red radiation, visible light⁶, ultraviolet radiation, X-rays, and gamma rays. Whereas EMR causes energy to be radiated

⁵ Frequency is a measure of the number of times per second a wave oscillates or vibrates. The most common unit of measurement of frequency is the Hertz (Hz) where 1 Hz is equal to 1 cycle per second.

⁶ Visible light is a group (spectrum) of frequencies which can be sensed by the eyes of humans and various other creatures.

outwards from its source e.g., light from the sun or radio-frequency signals from a television transmitter, EMFs cause energy to be transferred along electric wires.

In the context of the EMF/health issue, the distinction between EMF and EMR is addressed by the New Zealand Ministry of Health in its public information booklet “Electric and Magnetic Fields and Your Health” (Ref A-2) as follows:

“The electric and magnetic fields around power lines and electrical appliances are not a form of radiation. The word “radiation” is a very broad term, but generally refers to the propagation of energy away from some source. For example, light is a form of radiation, emitted by the sun and light bulbs. ELF fields do not travel away from their source but are fixed in place around it. They do not propagate energy away from their source. They bear no relationship, in their physical nature or effects on the body, to true forms of radiation such as x-rays or microwaves.”

References

- A-1. World Health Organisation: Environmental Health Criteria Vol. 238: Extremely low frequency fields. (2007).
- A-2. New Zealand Ministry of Health: Electric and Magnetic Fields and Your Health. (2008).

Appendix B

Overview of EMF Health Issue

Research into EMFs and health is a complex area involving many scientific disciplines – from biology, physics and chemistry to medicine, biophysics, and epidemiology. Many of the health issues of interest to researchers are quite rare. In this context, it is well accepted by scientists that no study considered in isolation will provide a meaningful answer to the question of whether or not EMFs can contribute to adverse health effects. In order to make an informed conclusion from all of the research, it is necessary to consider the science in its totality. Over the years, governments and regulatory agencies around the world have commissioned independent scientific review panels to provide such overall assessments.

Extremely Low Frequency (ELF) Fields

The possibility of adverse health effects due to the EMFs associated with extremely low frequency electrical equipment has been the subject of extensive research throughout the world. To date, while adverse health effects have not been established, the possibility that they may exist cannot be ruled out.

While EMFs involve both electric and magnetic components, electric fields are relatively constant over time, are readily shielded and, in the health context, are generally no longer associated with the same level of interest as magnetic fields. Nevertheless, high electric field strengths, such as those associated with high voltage equipment in major substations can approach a level at which “nuisance shocks” can occur and this phenomenon needs to be managed. Magnetic fields are not readily shielded, are more ubiquitous and remain the subject of some debate. Accordingly, much of the remainder of this section is directed towards magnetic fields.

The most recent scientific reviews by authoritative bodies are reassuring for most potential health issues. However, statistical associations⁷ between prolonged exposure to elevated magnetic fields and childhood leukaemia have persisted. This led the International Agency for Research on Cancer (IARC) (Ref. B-1) in 2002 to classify magnetic fields as a “possible carcinogen”⁸

The fact that, despite over 30 years of laboratory research, no mechanism for an effect has been established, lends weight to the possibility that the observed statistical associations reflect some factor other than a causal relationship. This point is made in the 2001 report of the UK National Radiological Protection Board’s (NRPB) Advisory Group, chaired by eminent epidemiologist, the late Sir Richard Doll (Ref. B-2)

“In the absence of clear evidence of a carcinogenic effect in adults, or of a plausible explanation from experiments on animals or isolated cells, the evidence is currently not strong enough to justify a firm conclusion that such fields cause leukaemia in children” (page 164)

References

B-1. World Health Organisation, International Agency for Research on Cancer, Lyon, France: IARC Monographs on the evaluation of carcinogenic risks to humans. Non-Ionising Radiation Part 1: Static and Extremely Low Frequency (ELF) Electric and Magnetic Fields. (2001)

⁷ It should be noted that a statistical association does not necessarily reflect a cause-and-effect relationship.

⁸ IARC publishes authoritative independent assessment by international experts of the carcinogenic risks posed to humans by a variety of agents, mixtures, and exposures. These agents, mixtures and exposures are categorised into 5 groups, namely:

Group 1 - the agent is carcinogenic to humans – 118 agents are included in the group, including asbestos, tobacco, and ultraviolet radiation

Group 2A - the agent is probably carcinogenic – 79 agents have been included in this group, including diesel engine exhaust, creosotes, and PCBs

Group 2B – the agent is possibly carcinogenic to humans – 290 agents have been included in this group, including coffee, gasoline, lead, nickel, petrol engine exhaust and extremely low frequency magnetic fields

Group 3 – the agent is not classifiable as to carcinogenicity – 501 agents have been included in this group, including caffeine, coal dust, extremely low frequency electric fields and static electric and magnetic fields

Group 4 – the agent is probably not carcinogenic to humans – only 1 agent (caprolactam) has been included in this group.

B-2. National Radiological Protection Board, (UK), ELF Electromagnetic Fields and the Risk of Cancer, Report of an Advisory Group on Non-Ionising Radiation, Chairman, Sir Richard Doll, NRPB Vol. 12 No. 1, 2001.

Appendix C

Health Guidelines

Health Guidelines for Extremely Low Frequency Electric and Magnetic Fields

The World Health Organisation recognises two international EMF/Health guidelines:

- the Guidelines for Limiting Exposure to Time-varying Electric and Magnetic Fields (1Hz to 100kHz) produced by the International Commission on Non-Ionising Radiation Protection (ICNIRP) Ref C-1), and
- the, IEEE Standard C95.1, produced by the International Committee on Electromagnetic Safety, Institute of Electrical and Electronics Engineers (IEEE) in the USA.

In July 2015, the relevant Australian regulator (ARPANSA) officially adopted the more conservative of the above two, the ICNIRP 2010 Guidelines, in full, stating:

“The ICNIRP ELF guidelines are consistent with ARPANSA’s understanding of the scientific basis for the protection of the general public (including the foetus) and workers from exposure to ELF EMF.”
(Ref. C-2)

In line with the regulator’s advice, Aurecon has applied the current international ICNIRP guideline reference levels to this assessment.

The reference levels for both electric and magnetic fields contained in the current ICNIRP guidelines are summarised in Table C-2.

Table C-2: Health Guideline Reference Levels

Parameter	ICNIRP 2010 Reference Levels
Electric Fields – General Public	5kV/m
Electric Fields – Occupational	10kV/m
Magnetic Fields – General Public	2,000mG
Magnetic Fields – Occupational	10,000mG

In applying the guidelines, it is to be noted that, unlike earlier versions, the various limits are now independent of duration of exposure.

In applying the ICNIRP Guideline, it is also important to recognise that the numerical limits, e.g., 2,000 mG, are based on established health effects. In ICNIRP’s fact sheet on the guidelines (Ref. C-3), it notes that:

“It is the view of ICNIRP that the currently existing scientific evidence that prolonged exposure to low frequency magnetic fields is causally related with an increased risk of childhood leukaemia is too weak to form the basis for exposure guidelines. Thus, the perception of surface electric charge, the direct stimulation of nerve and muscle tissue and the induction of retinal phosphenes are the only well-established adverse effects and serve as the basis for guidance.”

Being based on established biological effects (which occur at field levels much higher than those normally encountered in the vicinity of electrical equipment), the (numerical) exposure limits in the guidelines and standards cannot be said to define safe limits for possible health effects, should these exist, from magnetic fields at levels normally encountered in the vicinity of electrical equipment.

It is in this context that precautionary measures for ELF magnetic fields such as “Prudent Avoidance” have arisen (see Appendix D).

References

- C-1 International Commission on Non-Ionising Radiation Protection (2010: Guidelines for Limiting Exposure to Time-varying Electric and Magnetic Fields (1Hz to 100kHz): Health Physics 99(6):818-836; (2010).
- C-2 ARPANSA: Extremely Low Frequency Electric and Magnetic Fields – 2015, accessed 10 May 2016.
- C-3. ICNIRP Fact Sheet on the guidelines for limiting exposure to time-varying electric, and magnetic fields (1Hz-100kHz) published in Health Physics 99(6): 818-836; 2010, accessed 10 May 2016, <<http://www.icnirp.org/cms/upload/publications/ICNIRPFactSheetLF.pdf>>.

Appendix D

Prudent Avoidance

Extremely Low Frequency Magnetic Fields

Regarding the potential health effects from ELF magnetic fields, while compliance with the relevant guideline is important in protecting people from established health effects, it does not necessarily address possible health effects, should they exist, from fields at levels normally encountered in the vicinity of electrical equipment. The possibility of such effects has been comprehensively studied over several decades worldwide but, to this day, there is no clear understanding of how ELF electric or magnetic fields at low levels could pose a threat to human health.

Since the late 1980s, many reviews of the scientific literature have been published by authoritative bodies. There have also been several inquiries such as those by Sir Harry Gibbs in NSW (Ref. D-1) and Professor Hedley Peach in Victoria (Ref. D-2). These reviews and inquiries have consistently found that:

- Adverse health effects have not been established
- The possibility cannot be ruled out
- If there is a risk, it is more likely to be associated with the magnetic field than the electric field

Both Sir Harry Gibbs and Professor Peach recommended a policy of prudence or prudent avoidance, which Sir Harry Gibbs described in the following terms:

“... [doing] whatever can be done without undue inconvenience and at modest expense to avert the possible risk ...”

In 1999, the (US) National Institute of Environmental and Health Sciences (NIEHS) (Ref. D-3) found:

“In summary, the NIEHS believes that there is weak evidence for possible health effects from ELF-EMF exposures, and until stronger evidence changes this opinion, inexpensive and safe reductions in exposure should be encouraged.” (Page 38)

The practice of ‘prudent avoidance’ has been adopted by the (Australian) Energy Networks Association (ENA) and most Australian power utilities, including Ausgrid.

The World Health Organisation has also addressed the notion of prudence or precaution on several occasions, including in its 2007 publication Extremely low frequency fields. Environmental Health Criteria, Vol. 238 (Ref. D-4), which states:

“...the use of precautionary approaches is warranted. However, it is not recommended that the limit values in exposure guidelines be reduced to some arbitrary level in the name of precaution. Such practice undermines the scientific foundation on which the limits are based and is likely to be an expensive and not necessarily effective way of providing protection.”

It also states:

“Provided that the health, social and economic benefits of electric power are not compromised, implementing very low-cost precautionary procedures to reduce exposure is reasonable and warranted.”

Given the inconclusive nature of the science, it is considered that a prudent approach continues to be the most appropriate response in the circumstances. Under this approach, subject to modest cost and reasonable convenience, power utilities and transport authorities should design their facilities to reduce the intensity of the fields they generate, and locate them to minimise the fields that people, especially children, encounter over prolonged periods. While these measures are prudent, it cannot be said that they are essential or that they will result in any benefit.

In the Australian context, ENA’s position, as adopted in their EMF Management Handbook (Ref. D-5), states:

“Prudent avoidance does not mean there is an established risk that needs to be avoided. It means that if there is uncertainty, then there are certain types of avoidance (no cost / very low-cost measures) that could be prudent.”

It also states:

“Both prudent avoidance and the precautionary approach involve implementing no cost and very low-cost measures that reduce exposure while not unduly compromising other issues.”

References

- D-1. Gibbs, Sir Harry, Chairman, Inquiry into Community Needs and High Voltage Transmission Line Development, Submission to the NSW Government, February 1991.
- D-2. Peach HG, Bonwick WJ and Wyse T (1992). Report of the Panel on Electromagnetic Fields and Health to the Victorian Government (Peach Panel Report). Melbourne, Victoria: September 1992.
- D-3. National Institute of Environmental Health Sciences, National Institutes of Health, (USA), NIEHS report on health effects from exposure to power-line frequency electric and magnetic fields, NIH Publication No. 99-4493, 1999.
- D-4. World Health Organisation: Environmental Health Criteria Vol. 238: Extremely low frequency fields. (2007).
- D-5. Energy Networks Association: EMF Management Handbook. (2016).

Document prepared by

Aurecon Australasia Pty Ltd

ABN 54 005 139 873

Level 5, 116 Military Road

Neutral Bay NSW 2089

PO Box 538

Neutral Bay NSW 2089

Australia

T +61 2 9465 5599

F +61 2 9465 5598

E sydney@aurecongroup.com

W aurecongroup.com

