
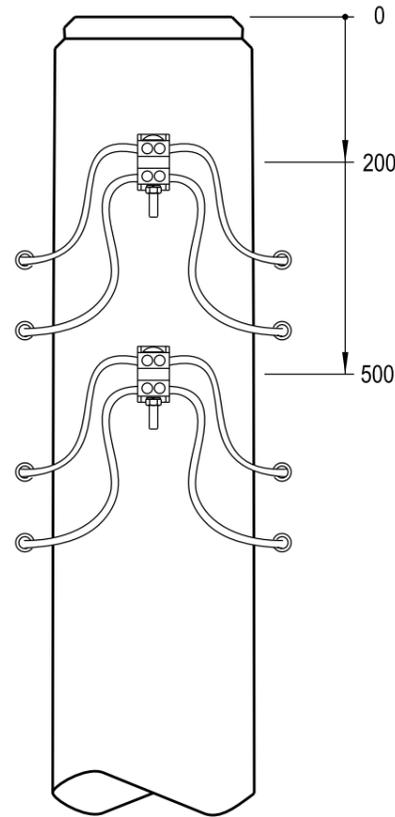


LENGTH OF EXPOSED
THREAD BETWEEN
NUTS TO BE MINIMISED

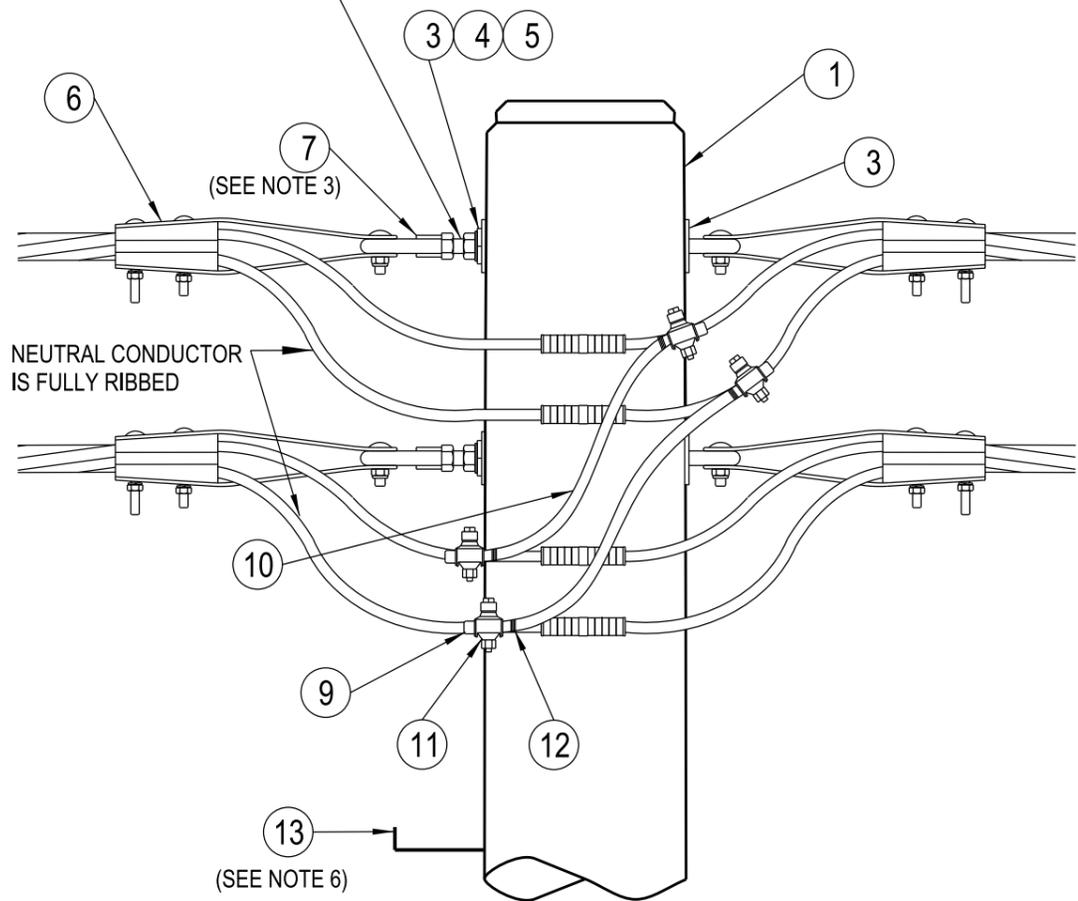

NOTES :

1. THE FOLLOWING INFORMATION IS OBTAINED FROM THE PROJECT DESIGN DRAWINGS :
 - a. POLE LENGTH AND STRENGTH.
 - b. SPECIAL FOUNDATION REQUIREMENTS.
 - c. POLE EMBEDMENT DEPTH.
 - d. CONDUCTOR SIZE.
 - e. STAY REQUIREMENTS.
 - f. DEVIATION ANGLE.
2. THE MAXIMUM LINE DEVIATION ANGLE TO BE CONSTRUCTED ON THIS ARRANGEMENT IS TO BE DETERMINED BY THE LINE DESIGNER WITH CONSIDERATION TO THE LOAD CAPABILITIES OF THE EYEBOLT AND EYENUT ASSEMBLIES.
3. THE LOAD AND DEVIATION ALLOWABLE ON THE EYEBOLT AND EYENUT ASSEMBLY IS TO BE DETERMINED FROM DRG : 520331.
4. POLES SHALL BE DRILLED, SCARFED AND DRESSED ON SITE. DRILLING AND SCARFING TO BE TREATED WITH APPROVED PRESERVATIVES.
5. ALL BOLTS PASSING THROUGH TIMBER ARE TO BE COATED WITH GRAPHITE GREASE.
6. POLE STEPS ARE TO BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF NS125. APPROXIMATELY 100m INTERVALS.
7. THIS BONDING ARRANGEMENT BETWEEN PARALLEL CABLES TO BE UTILISED AT APPROXIMATELY 100m INTERVALS.
8. PRE-INSULATED ALUMINIUM COMPRESSION SLEEVES TO BE USED WHEN REQUIRED TO JOIN CONDUCTORS.

13	STEP - POLE, SCREW-IN (SEE NOTE 6)	250144	185198	A/R
12	TIE - CABLE, 382x7.5mm, BLACK, PVC		59907	8
11	CONNECTOR - INSULATION PIERCING CLAMP, 95-150mm ² TO 95-150mm ²		176591	8
10	CONDUCTOR - OVERHEAD, TAPPINGS (TO SUIT CONDUCTOR SIZE)			4m
9	CAP - END, PUSH ON (TO SUIT 95mm ² & 150mm ² LV ABC)		H77222	8
8	SLEEVE - COMPRESSION, NON TENSION, PRE-INSULATED (TO SUIT 95mm ² LV ABC)	514053	H19073	8
	SLEEVE - COMPRESSION, PRE-INSULATED (TO SUIT 150mm ² LV ABC)	514053	150987	
7	EYENUT - M20, GALVANISED (SEE NOTE 3)	513951	H38853	2
6	CLAMP - TERMINATION (TO SUIT 4x95mm ² LV ABC)		176651	4
	CLAMP - TERMINATION (TO SUIT 4x150mm ² LV ABC)		176652	
5	WASHER - FLAT, M20, GALVANISED	518081	177986	2
4	WASHER - CONICAL, M20, GALVANISED	518082	H39655	2
3	WASHER - SQUARE, 75x75x6mm, GALVANISED (Ø22mm HOLE)	518081	H39231	4
2	EYEBOLT - M20, GALVANISED (LENGTH TO SUIT POLE)(SEE NOTE 3)	513653		2
1	POLE - TIMBER (AS REQUIRED)	513988		1

ITEM	DESCRIPTION	DRG.NO	STOCK CODE	QTY
------	-------------	--------	------------	-----



ALL DIMENSIONS IN MILLIMETRES UNLESS NOTED OTHERWISE.

DO NOT SCALE.

CAD DRAWING
DO NOT MANUALLY AMEND
AMENDMENTS
DWN: PATRICIA RIOS
CHKD: PHILLIP JONES
DATE: 02/01/2020
POLE STEPS ADDED.
NOTES & MATERIAL LIST
AMENDED.
3
APP'D by: GLENN FORD



145 NEWCASTLE RD WALLSEND,
NSW 2287

SCALE	1:10
DESIGNED	-
DRAWN	GARRY CRAIG
CHECKED	GARRY CRAIG
APPROVED	GLENN FORD
DATE	16/05/13
PROJECT NUMBER	NET-STD
PROJTRAK NUMBER	STD

STANDARD CONSTRUCTION
LV ABC THROUGH TERMINATION
PARALLEL BONDED CONSTRUCTION
1-74B

SIZE	DRAWING No	SHEET	AMD
A3	514013	02	3