


**SECTION A-A**

N.T.S.  
ORIENTATION FOR  
POLE STEP HOLES

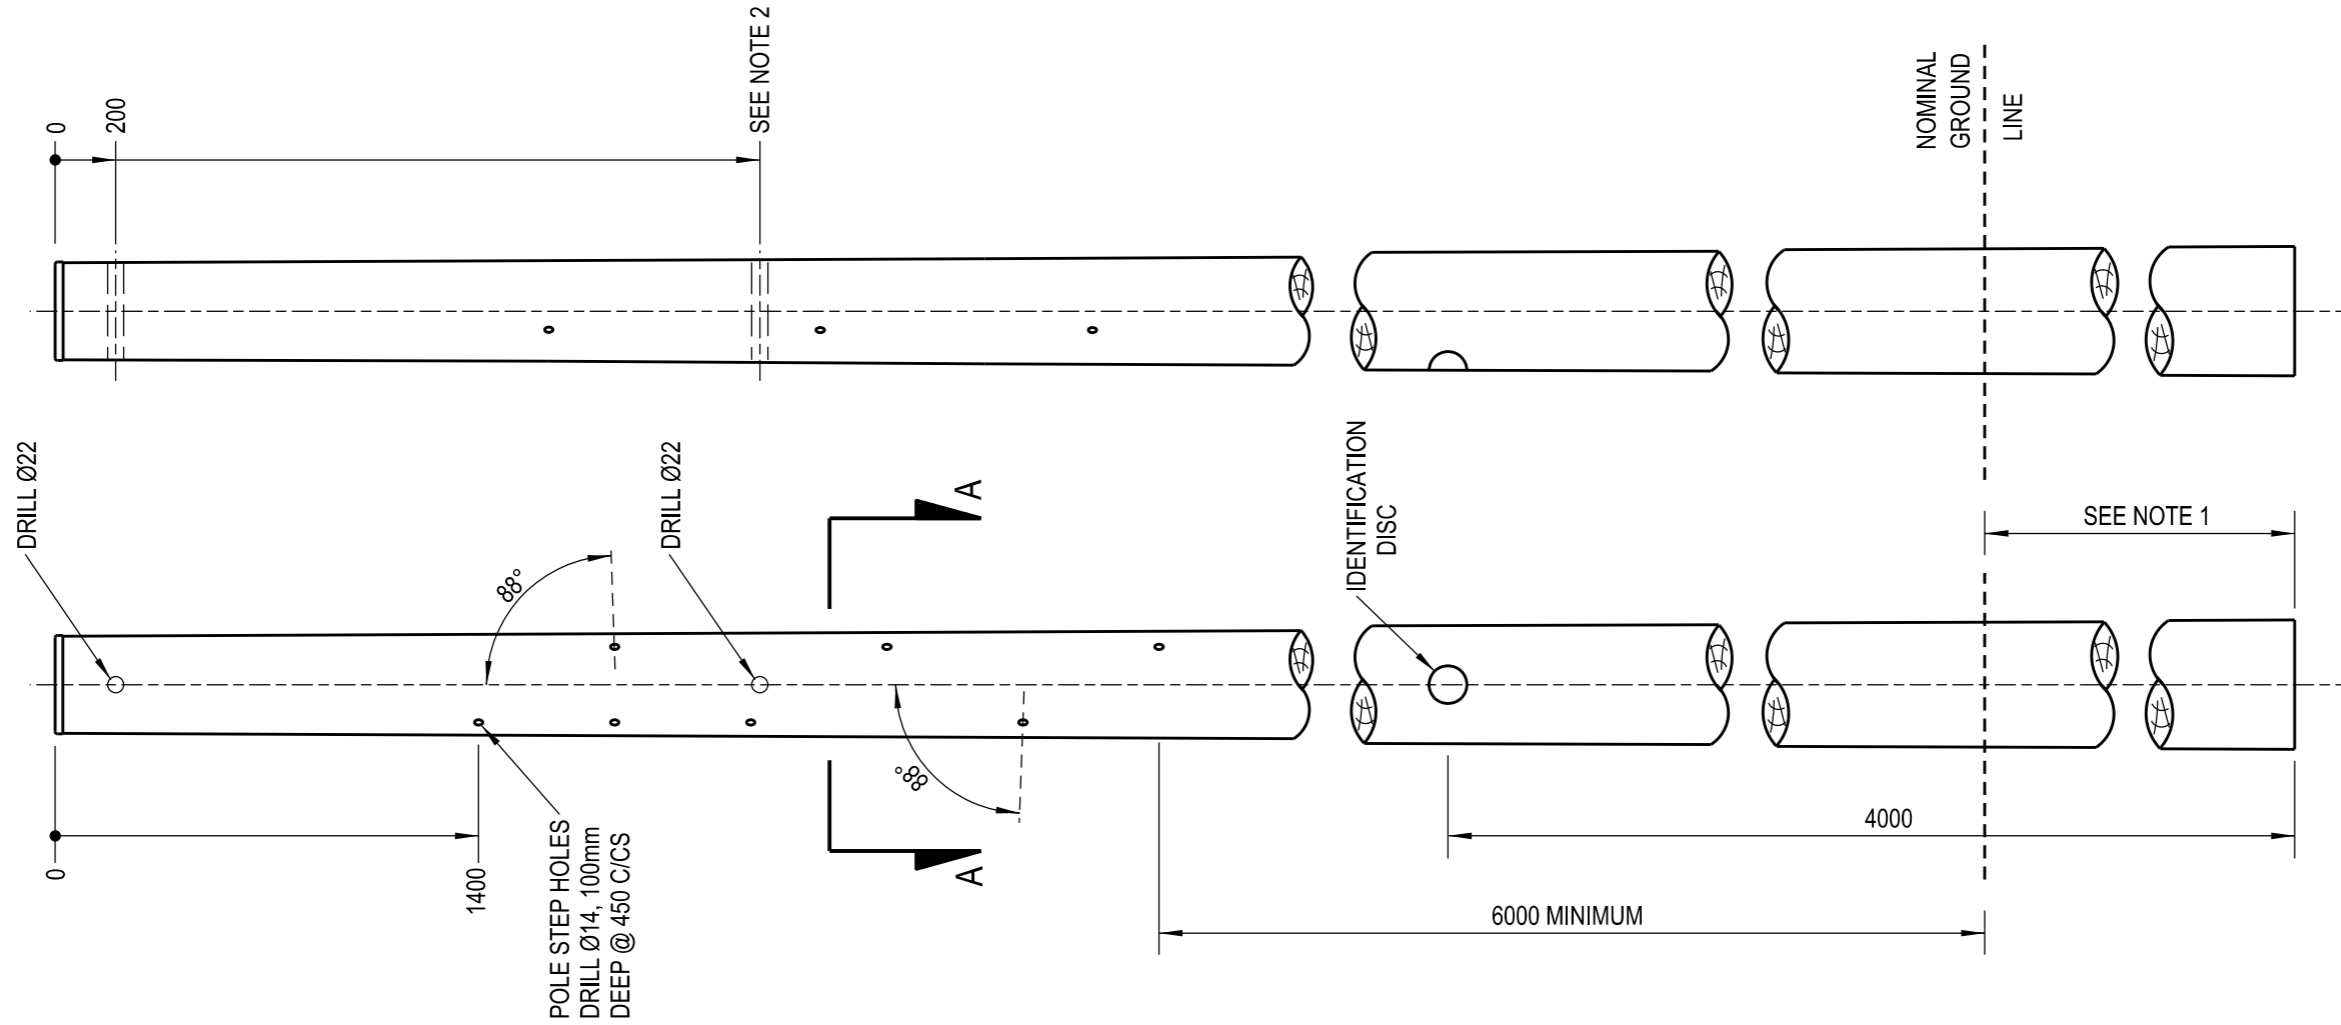

**NOTES :**  
 1. THE MINIMUM POLE EMBEDMENT DEPTH IS TO BE DESIGNED USING AUSGRID'S POLE EMBEDMENT CALCULATOR (PEC) AND COMPLY WITH THE REQUIREMENTS OF NS220.  
 2. THE LOCATION OF UNDERBUILT CIRCUITS WILL BE SPECIFIED BY THE LINE DESIGNER AND SHOWN IN THE CONSTRUCTION SCHEDULE ON THE PROJECT DESIGN DRAWINGS.

LENGTH (m)	STRENGTH (kN)	STOCK CODE
14.00	6	H23313
14.00	8	146746
14.00	12	146753

**DRESSING FOR  
6, 8 AND 12 kN POLES**

DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE

CAD DRAWING DO NOT MANUALLY AMEND	
A M E N D M E N T S	
DWN: PATRICIA RIOS	
CHKD: PHILLIP JONES	
DATE: 19/11/2014	
8 AUSGRID BORDER ADDED. STOCK CODES AMENDED.	
APP'D by: DOMINIC SHIELDS	
DWN: P.R.	
CHKD: P.J.	
APP'D: G.F.	
DATE: 05/09/2024	
9 NOTES ADDED. GENERAL AMENDMENTS	

NETWORK STANDARD  
  
 145 NEWCASTLE RD WALLSEND,  
 NSW 2287

SCALE	1:25
DESIGNED	-
DRAWN	P.S
CHECKED	P.S
APPROVED	I.NICHOLS
DATE	20/08/1992
PROJECT NUMBER	STD
PROJTRAK NUMBER	-

STANDARD CONSTRUCTION DRESSING DETAILS FOR 14.0m TIMBER POLES			
SIZE	DRAWING No	SHEET	REV
A3	515281	1	9