


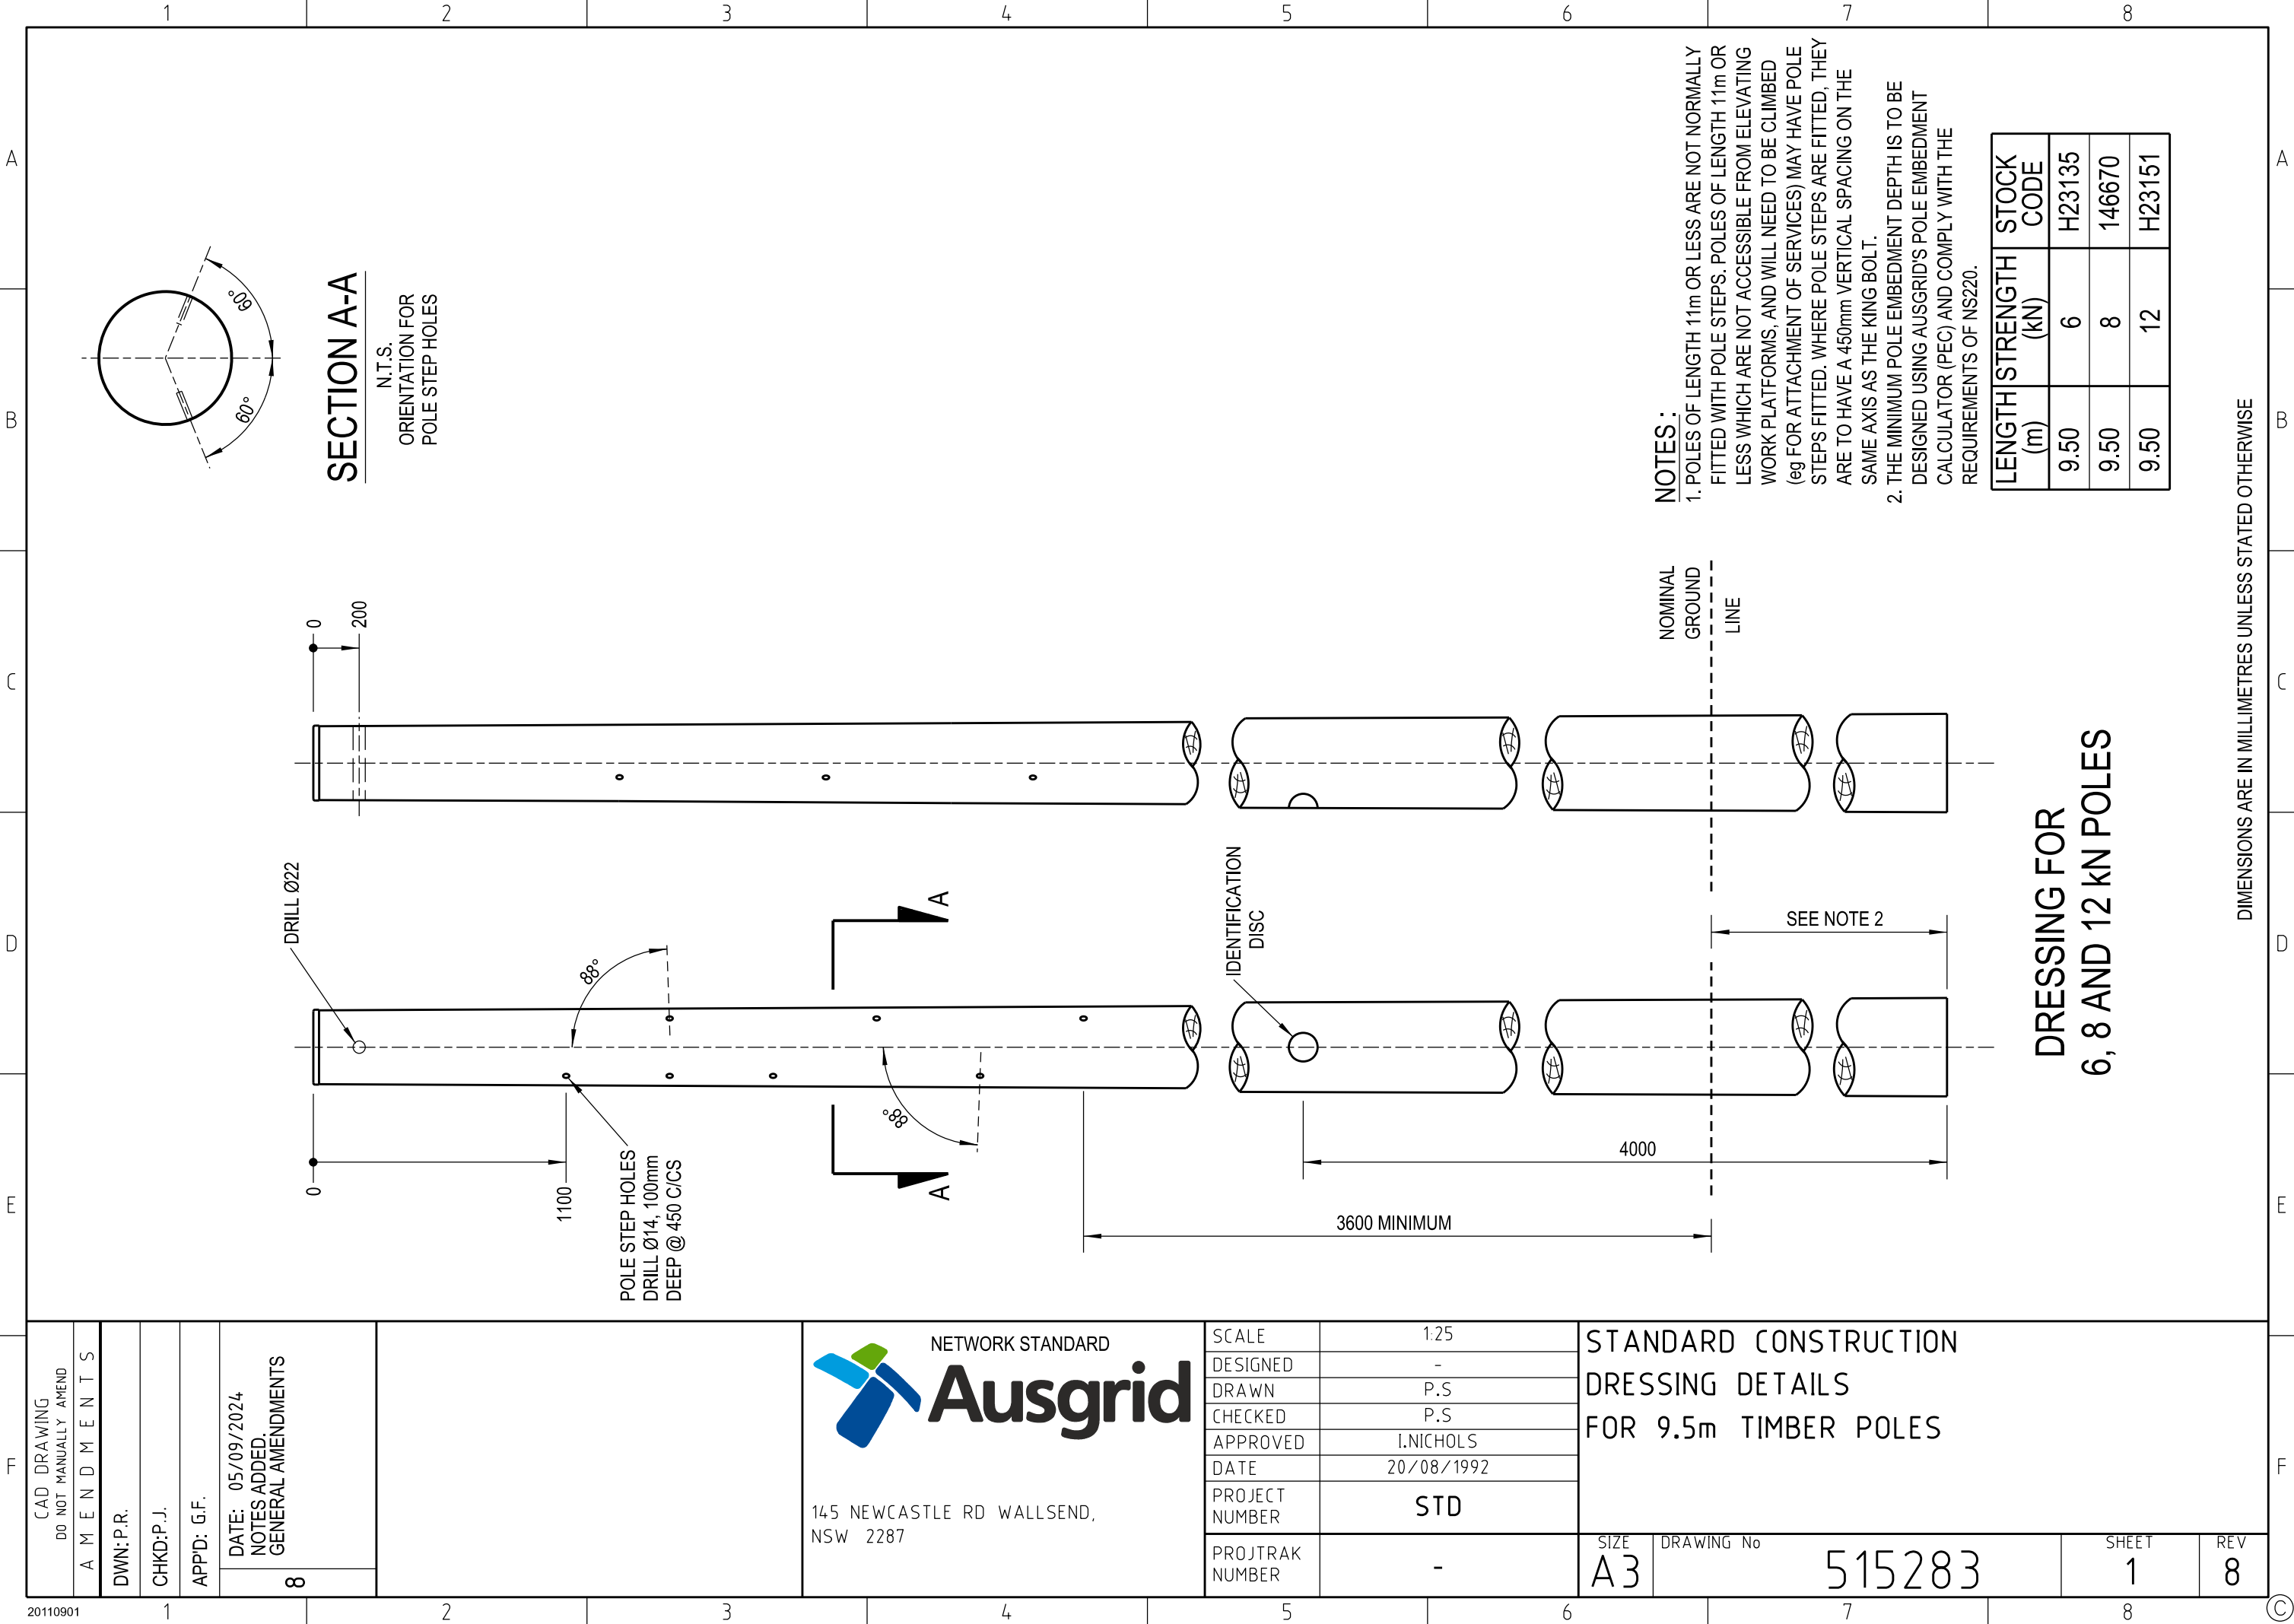

NOTES:

1. POLES OF LENGTH 11m OR LESS ARE NOT NORMALLY FITTED WITH POLE STEPS. POLES OF LENGTH 11m OR LESS WHICH ARE NOT ACCESSIBLE FROM ELEVATING WORK PLATFORMS, AND WILL NEED TO BE CLIMBED (eg FOR ATTACHMENT OF SERVICES) MAY HAVE POLE STEPS FITTED. WHERE POLE STEPS ARE FITTED, THEY ARE TO HAVE A 450mm VERTICAL SPACING ON THE SAME AXIS AS THE KING BOLT.

2. THE MINIMUM POLE EMBEDMENT DEPTH IS TO BE DESIGNED USING AUSGRID'S POLE EMBEDMENT CALCULATOR (PEC) AND COMPLY WITH THE REQUIREMENTS OF NS220.

LENGTH (m)	STRENGTH (kN)	STOCK CODE
9.50	6	H23135
9.50	8	146670
9.50	12	H23151

CAD DRAWING DO NOT MANUALLY AMEND	A M E N D M E N T S	DWN: P.R.	CHKD: P.J.	APP'D: G.F.	DATE: 05/09/2024 NOTES ADDED. GENERAL AMENDMENTS
20110901	1				8

 145 NEWCASTLE RD WALLSEND, NSW 2287		SCALE	1:25	STANDARD CONSTRUCTION DRESSING DETAILS FOR 9.5m TIMBER POLES			
		DESIGNED	-				
		DRAWN	P.S				
		CHECKED	P.S				
		APPROVED	I.NICHOLS				
		DATE	20/08/1992				
		PROJECT NUMBER	STD				
		PROJTRAK NUMBER	-	SIZE	DRAWING No	SHEET	REV
				A3	515283	1	8