

NOTES:

1. THE FOLLOWING INFORMATION TO BE OBTAINED FROM THE LINE SCHEDULE;
 - a) POLE LENGTH
 - b) SPECIAL FOUNDATION REQUIREMENTS
 - c) VARIATIONS TO STANDARD POLE DEPTH
 - d) CONDUCTOR AND O.H.E.W. SIZES
 - e) STAY REQUIREMENTS
 - f) DEVIATION ANGLE
 - g) ASSESSED EARTHING REQUIREMENTS

POLE LENGTH	'D' STANDARD DEPTH	'U'
m	m	m
18.5	2.45	11.325
20.0	2.60	12.675
21.5	2.75	14.025
23.0	2.90	15.375
24.0	3.00	16.275
26.0	3.20	18.075


	FROM DATUM	
	X	Y
O.H.E.W.	344	-158
LOAD CENTRE O.H.E.W.	0	0
CONDUCTOR 'A'	1974	225
CONDUCTOR 'B'	-1984	-875
CONDUCTOR 'C'	1994	-1975
LOAD CENTRE CONDUCTOR	0	-1100

ITEM	DESCRIPTION	DRG.No.	STOCK CODE	QTY.
5	CONCRETE POLE FOOTING ARRANGEMENT	512331		1
4	CONCRETE POLE BUTT PLATE EARTHING ARRANGEMENT	520209		1
3	OVERHEAD EARTHWIRE SUSPENSION ARRANGEMENT-1a	514088		1
2	OVERLOAD RELEASE HORIZONTAL LINE POST INSULATOR ARRANGEMENT -3	512206		3
1	POLE CONCRETE TYPE 6-200 C/E AND 6-202 C/E	514125		1

DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE DO NOT SCALE

CAD DRAWING DO NOT MANUALLY AMEND AMENDMENTS	INITIAL ISSUE
A. 15-01	
B. 15-01	
C. 28-05-91	
D. 19-08-94	
E. 11-11-2013	
F. 514124	

APPD by: GLENN FORD	
DWN: GARY HUGHES	
CHKD: PHILLIP JONES	
DATE: 11/11/2013	
AUSGRID BORDER APPLIED.	
SUPERCEDED BY DRG: 514124.	

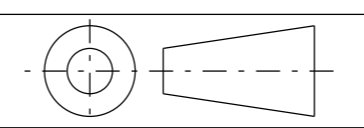

NETWORK STANDARD
Ausgrid
 145 NEWCASTLE RD WALLSEND,
 NSW 2287

SCALE	1:25
DESIGNED	
DRAWN	P.S.
CHECKED	
APPROVED	P.MOLLINSON
DATE	28/05/91
PROJECT NUMBER	STD
PROJTRAK NUMBER	

STANDARD CONSTRUCTION 132kV TRANSMISSION LINES STRUCTURE ASSEMBLY 6-202 C/E			
SIZE	DRAWING No	SHEET	AMD
A2	514143	01	5

ASSOCIATED DRAWINGS