

NOTES:

1. THE FOLLOWING INFORMATION TO BE OBTAINED FROM THE LINE SCHEDULE:
- a) POLE LENGTH, TYPE AND POLE CENTRES.
 - b) SPECIAL FOUNDATION REQUIREMENTS
 - c) VARIATIONS TO STANDARD POLE DEPTH
 - d) CONDUCTOR AND O.H.E.W. SIZES
 - e) STAY REQUIREMENTS
 - f) DEVIATION ANGLE
 - g) ASSESSED EARTHING REQUIREMENTS


POLE LENGTH m	'D' STANDARD DEPTH m	'U' m	'R' m	'A' m
18.5	2.45	8.925	5.57	4.82
20.0	2.60	10.275	6.92	6.17
21.5	2.75	11.625	8.27	7.52
23.0	2.90	12.975	9.62	8.87
24.0	3.00	13.875	10.52	9.77
26.0	3.20	15.675	12.32	11.57

	FROM DATUM	
	X	Y
O.H.E.W.	372	-53
LOAD CENTRE O.H.E.W.	0	0
CONDUCTOR 'A'	1976	225
CONDUCTOR 'B'	1996	-1975
CONDUCTOR 'C'	2016	-4175
LOAD CENTRE CONDUCTOR	0	-2200

ITEM	DESCRIPTION	DRG.No.	STOCK CODE	QTY.
5	CONCRETE POLE FOOTING ARRANGEMENT	A3-12331		2
4	CONCRETE MULTIPLE POLE WITH BUTT PLATE, EARTHING ARRANGEMENT	A2-20210		1
3	OVERHEAD LINE INTER POLE STAYING AND BONDING ARRANGEMENT - A	A2-20247		1
2	O/L OVERLOAD RELEASE HORIZONTAL LINE POST INSULATOR ARR-3	A2-12206		6
1	POLE CONCRETE TYPE 6-260 C/E AND 6-262 C/E	A2-20224		2

DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE

DO NOT SCALE

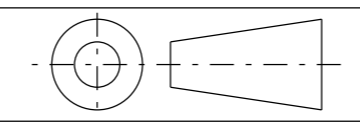

CAD DRAWING DO NOT MANUALLY AMEND AMENDMENTS A. DWN: P.S., CHKD: P.A.S. B. DWN: S.S., CHKD: S.S. DATE: 20-6-94 STAY REPAIRED TO 450 MM FROM POLE HEAD. AUTH'D BY: P. SUMNER		DWN: GARRY CRAIG CHKD: GARRY CRAIG DATE: 09/01/2014 AUSGRID BORDER APPLIED.		APP'D BY: LEIGH DUNKLEY DWN: PATRICIA RIOS CHKD: PHILLIP JONES DATE: 05/12/2017 AUSGRID BORDER APPLIED. SUPERCEDED BY DRG: 520229.		APP'D BY: DOMINIC SHIELDS	
ASSOCIATED DRAWINGS							

NETWORK STANDARD

Ausgrid

DESIGN & ENGINEERING BRANCH
 145 NEWCASTLE RD WALLSEND, NSW 2287
 Ph 02 4951 9388
 Fax 02 4951 9389

SCALE	1:25
DESIGNED	EA
DRAWN	
CHECKED	PAS
APPROVED	IAN NICHOLS
DATE	08/06/94
PROJECT NUMBER	STD
PROJ/TRAK NUMBER	

STANDARD CONSTRUCTION
 132KV TRANSMISSION LINE
 TWO POLE
 STRUCTURE ASSEMBLY
 6-262 C/E

SIZE	DRAWING No	SHEET	AMD
A2	520254	01	4