


# NS 171 DETAIL - APPENDIX B

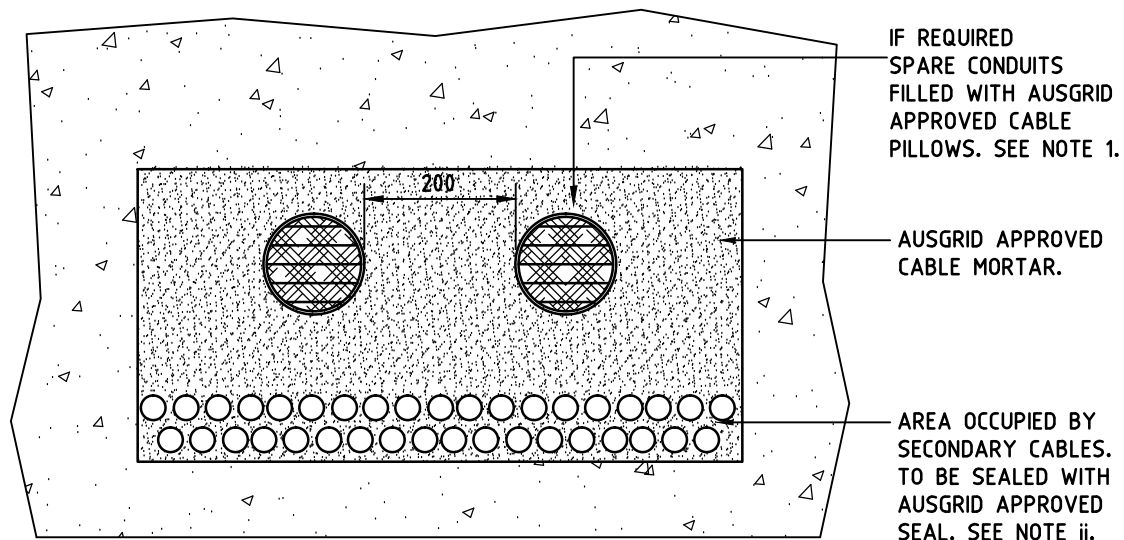

## SECTION

### NOTES:

1. WHERE FREQUENT DISTURBANCE OF SEAL IS EXPECTED PLACE AT LEAST ONE Ø125 CONDUIT. WHERE MORE THAN ONE SPARE CONDUIT IS REQUIRED PLACE CONDUITS AT 200mm INTERVALS.
2. ALSO APPLIES TO FLOOR PENETRATIONS WHERE PERMENANT FORMWORK IS USED.
3. SEAL MATERIALS ARE TO BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURERS INSTRUCTIONS.

### LIMITATIONS OF USE:

- i. MULTIPLE SPARE CONDUITS ARE NOT REQUIRED IN SWITCHGEAR CABLE SLOTS OR SLOTS CARRYING HV CABLES ONLY.
- ii. MORTAR OR CABLE BRICKS NOT TO BE USED WHERE SUBMERSION IN WATER IS LIKELY.

CAD DRAWING  
DO NOT MANUALLY AMEND  
AMENDMENTS  
1. NOTES AND SECTION  
REVISED.  
JA 07.01.04

2. NEW AUSGRID BORDER &  
LOGO ADDED.  
R.LAALAA 16.10.13  
APPROVED T.LAMPARD



SCALE	1:100
DESIGNED	
DRAWN	CJS
CHECKED	JW
APPROVED	M-DESIGN JW
DATE	18/07/2002

## SPARE CONDUIT SEAL DETAIL

PROJECT No. ES 102-9-1

PRJTRK No.

Sheet 1

A4 128118 2